




Part List			
Item n	Description	Material	Qty
1	3 Way Pillar Hydrant	Cast-Iron	01
2	2-1/2" LVT Outlet Adaptor	Brass	02
3	2-1/2" End Cap and Chain	Cast-Iron	02
4	4" Pumper Connection	Brass	01
5	4" End Cap and Chain	Cast-Iron	01

Technical Specification	
Description	Specification
Inlet Connection Flange	6" PN16
Design Pressure	16 bar
Test Pressure	24 bar

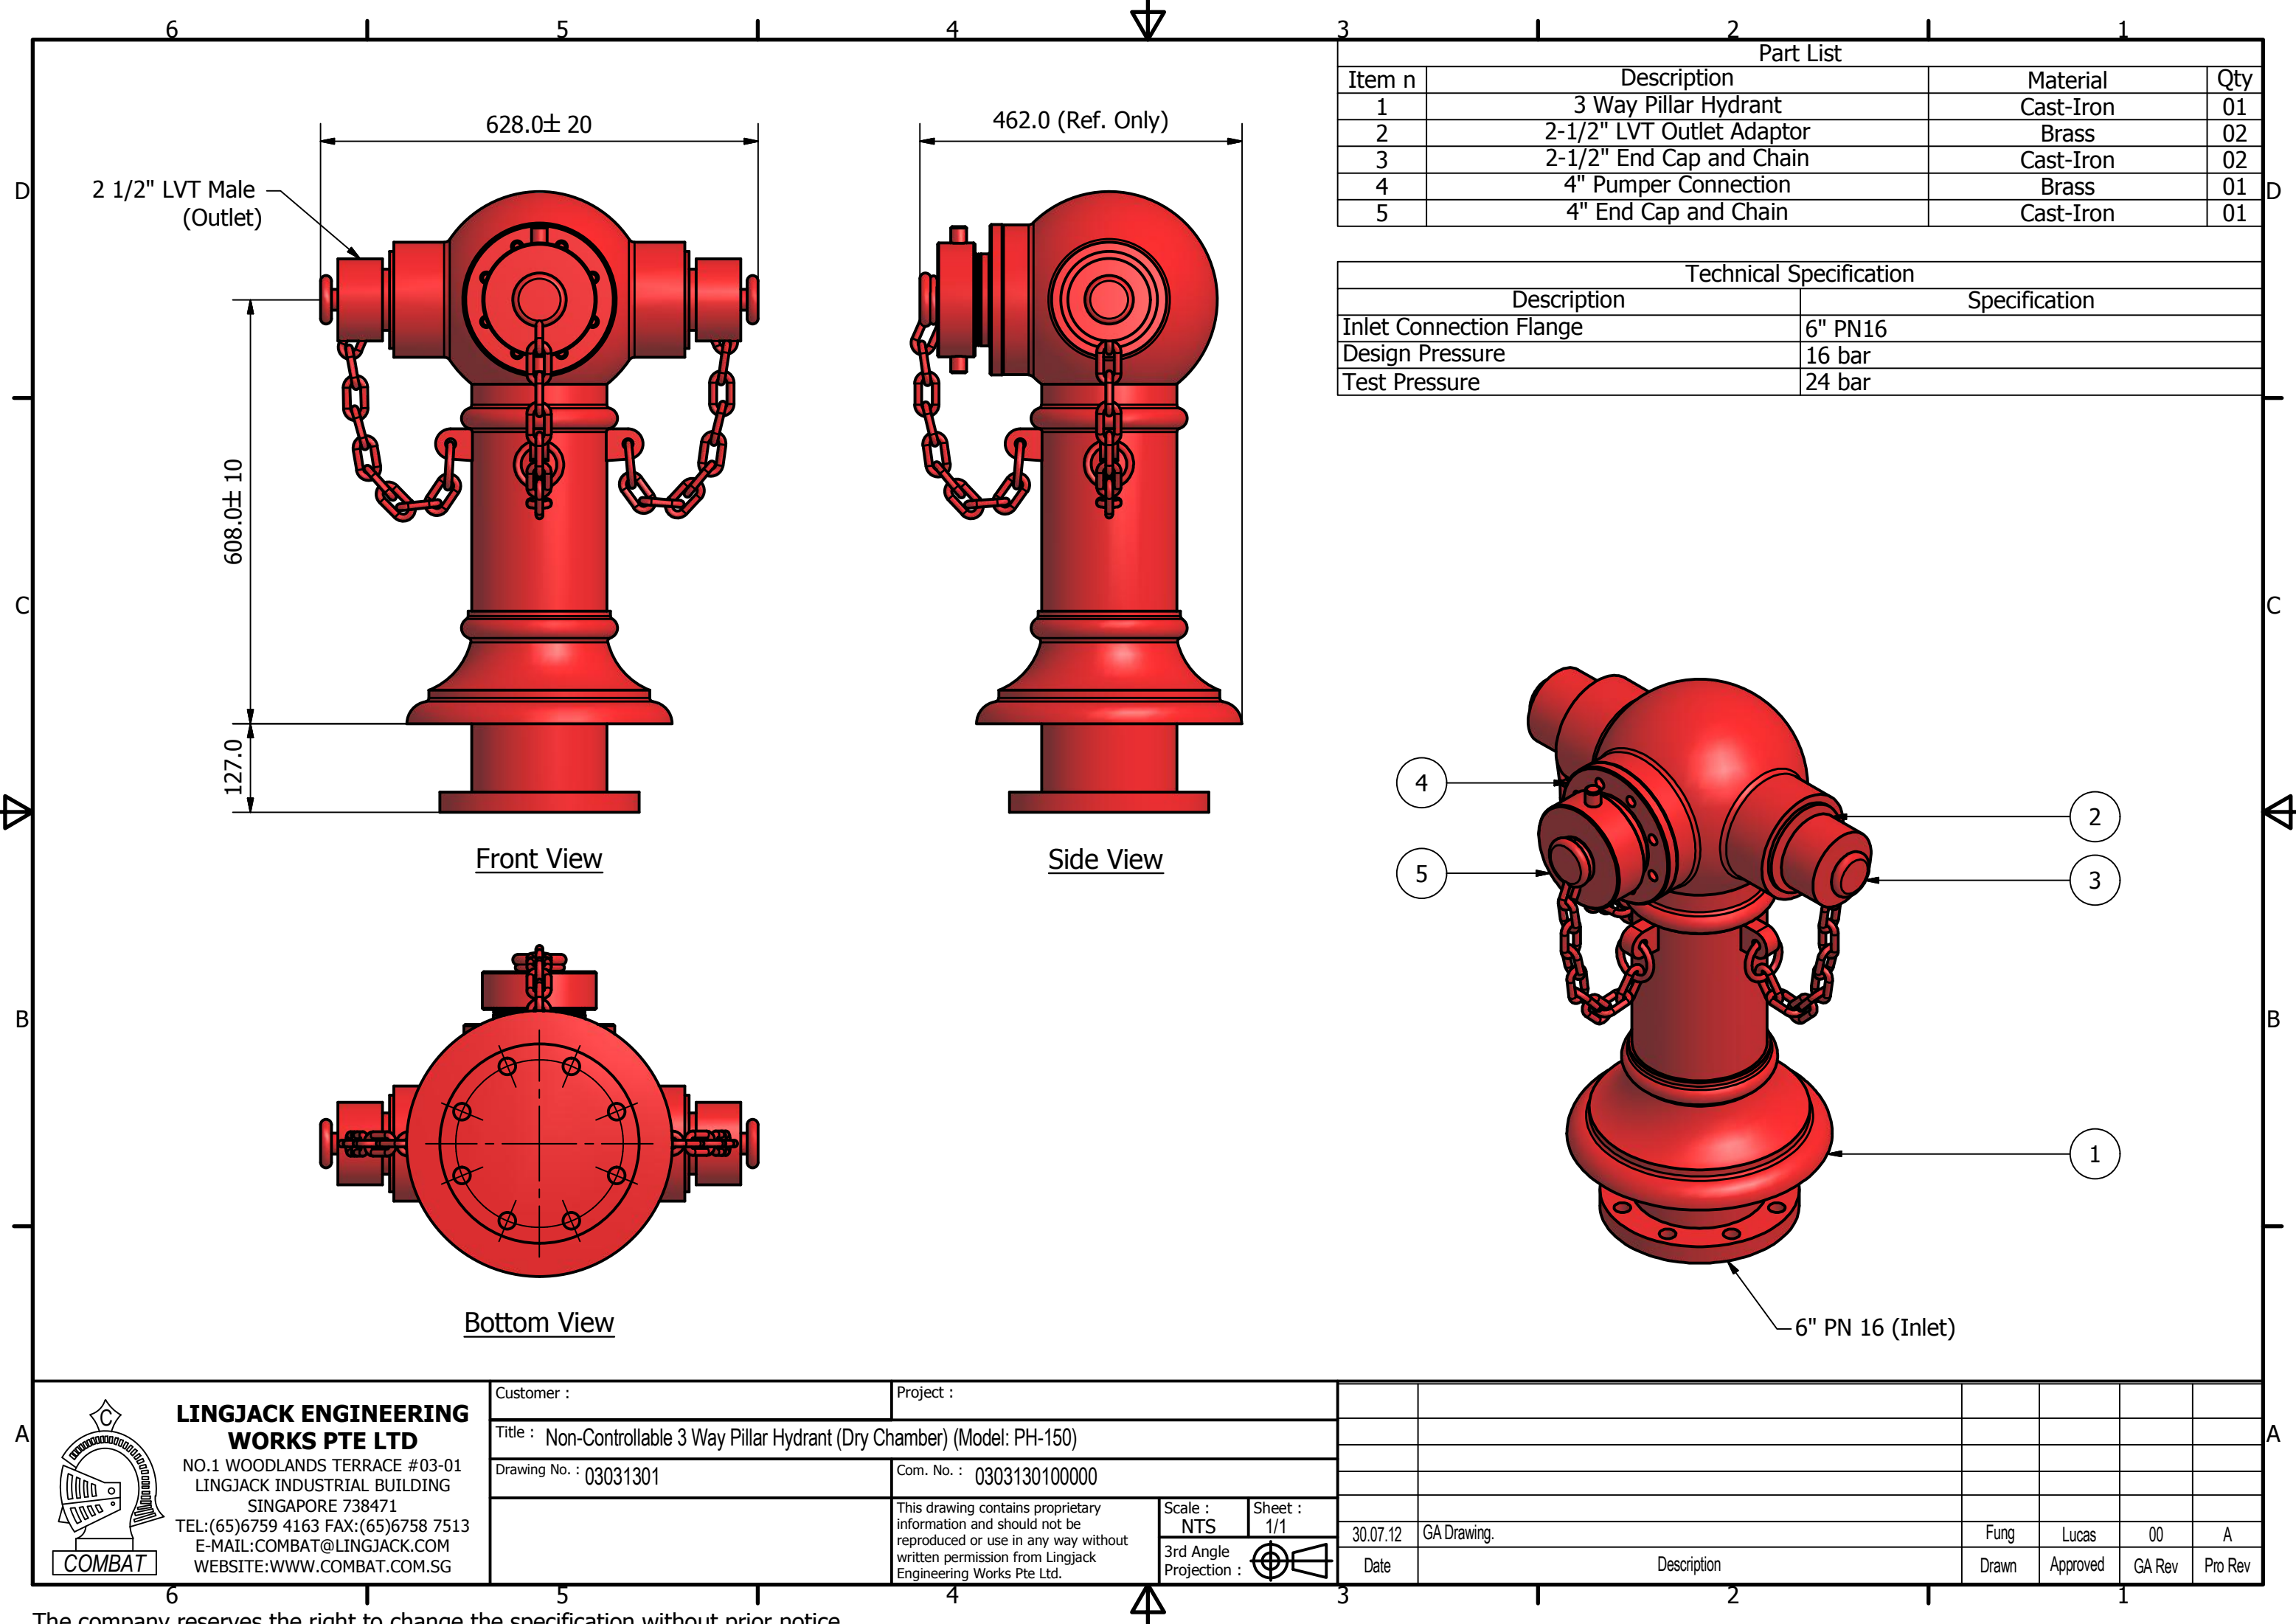

**LINGJACK ENGINEERING
WORKS PTE LTD**
NO.1 WOODLANDS TERRACE #03-01
LINGJACK INDUSTRIAL BUILDING
SINGAPORE 738471
TEL:(65)6759 4163 FAX:(65)6758 7513
E-MAIL:COMBAT@LINGJACK.COM
WEBSITE:WWW.COMBAT.COM.SG

Customer :		Project :		
Title : Non-Controllable 3 Way Pillar Hydrant (Dry Chamber) (Model: PH-150)				
Drawing No. : 03031301		Com. No. : 0303130100000		
		This drawing contains proprietary information and should not be reproduced or use in any way without written permission from Lingjack Engineering Works Pte Ltd.	Scale :	Sheet :
			NTS	1/1
			3rd Angle Projection :	